



**Pacific County Courthouse**  
National Historic Site


**Pacific County  
Department of Community Development**

PO Box 68 – 1216 W. Robert Bush Drive  
South Bend, WA 98586  
360-875-9356 Fax 360-875-9304

7013 Sandridge Road  
Long Beach, WA 98631  
360-642-9382 Fax 360-642-9387

[www.co.pacific.wa.us](http://www.co.pacific.wa.us)

# Propane Tank Setbacks

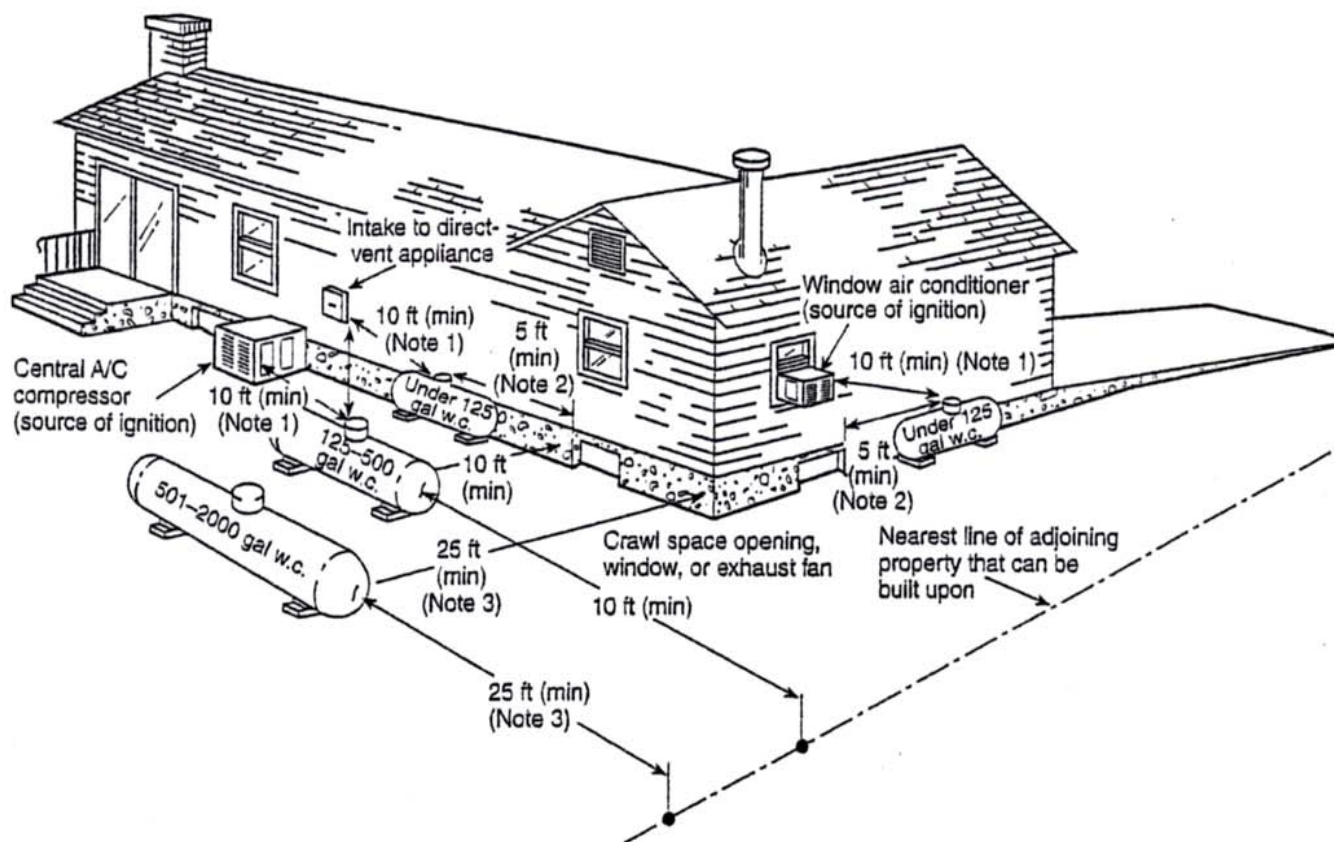

Regardless of its size, any ASME container filled on site must be located so that the filling connection and fixed maximum liquid level gauge are at least 10 ft from any external source of ignition (e.g., open flame, window A/C, compressor), intake to direct-vented gas appliance, or intake to a mechanical ventilation system.

This distance may be reduced to no less than 10 ft for a single container of 1200 gal (4.5 m<sup>3</sup>) water capacity or less, provided such container is at least 25 ft from any other LP-Gas container of more than 125 gal (0.5 m<sup>3</sup>) water capacity.